

GENERAL NOTES


DOCUMENT CENTRE

The survey is based on Ordnance Survey National Grid OSG83S.
 The accuracy of the digital data is the same as the plotting scale implies.
 All dimensions are in metres unless otherwise stated.
DO NOT SCALE from this drawing, work to site dimensions.

LEGEND

- PROPOSED 33kV OPEN CUT TRENCH ROUTE ---
- ALTERNATIVE 33kV OPEN CUT TRENCH ROUTE ---
- PROPOSED HDD ---
- SPECIAL ENGINEERING DIFFICULTY ---
- RAILWAY TRACK / TRAILLINE ---
- W/IND WATER

CIRCUIT	LENGTH (M)	PRIVATE LAND / PARKS	SPECIAL ENGINEERING DIFFICULTIES
33 kV CABLE	643	Part: Hearshall Common	5 (SECC SECC SECC SE011, SE012)

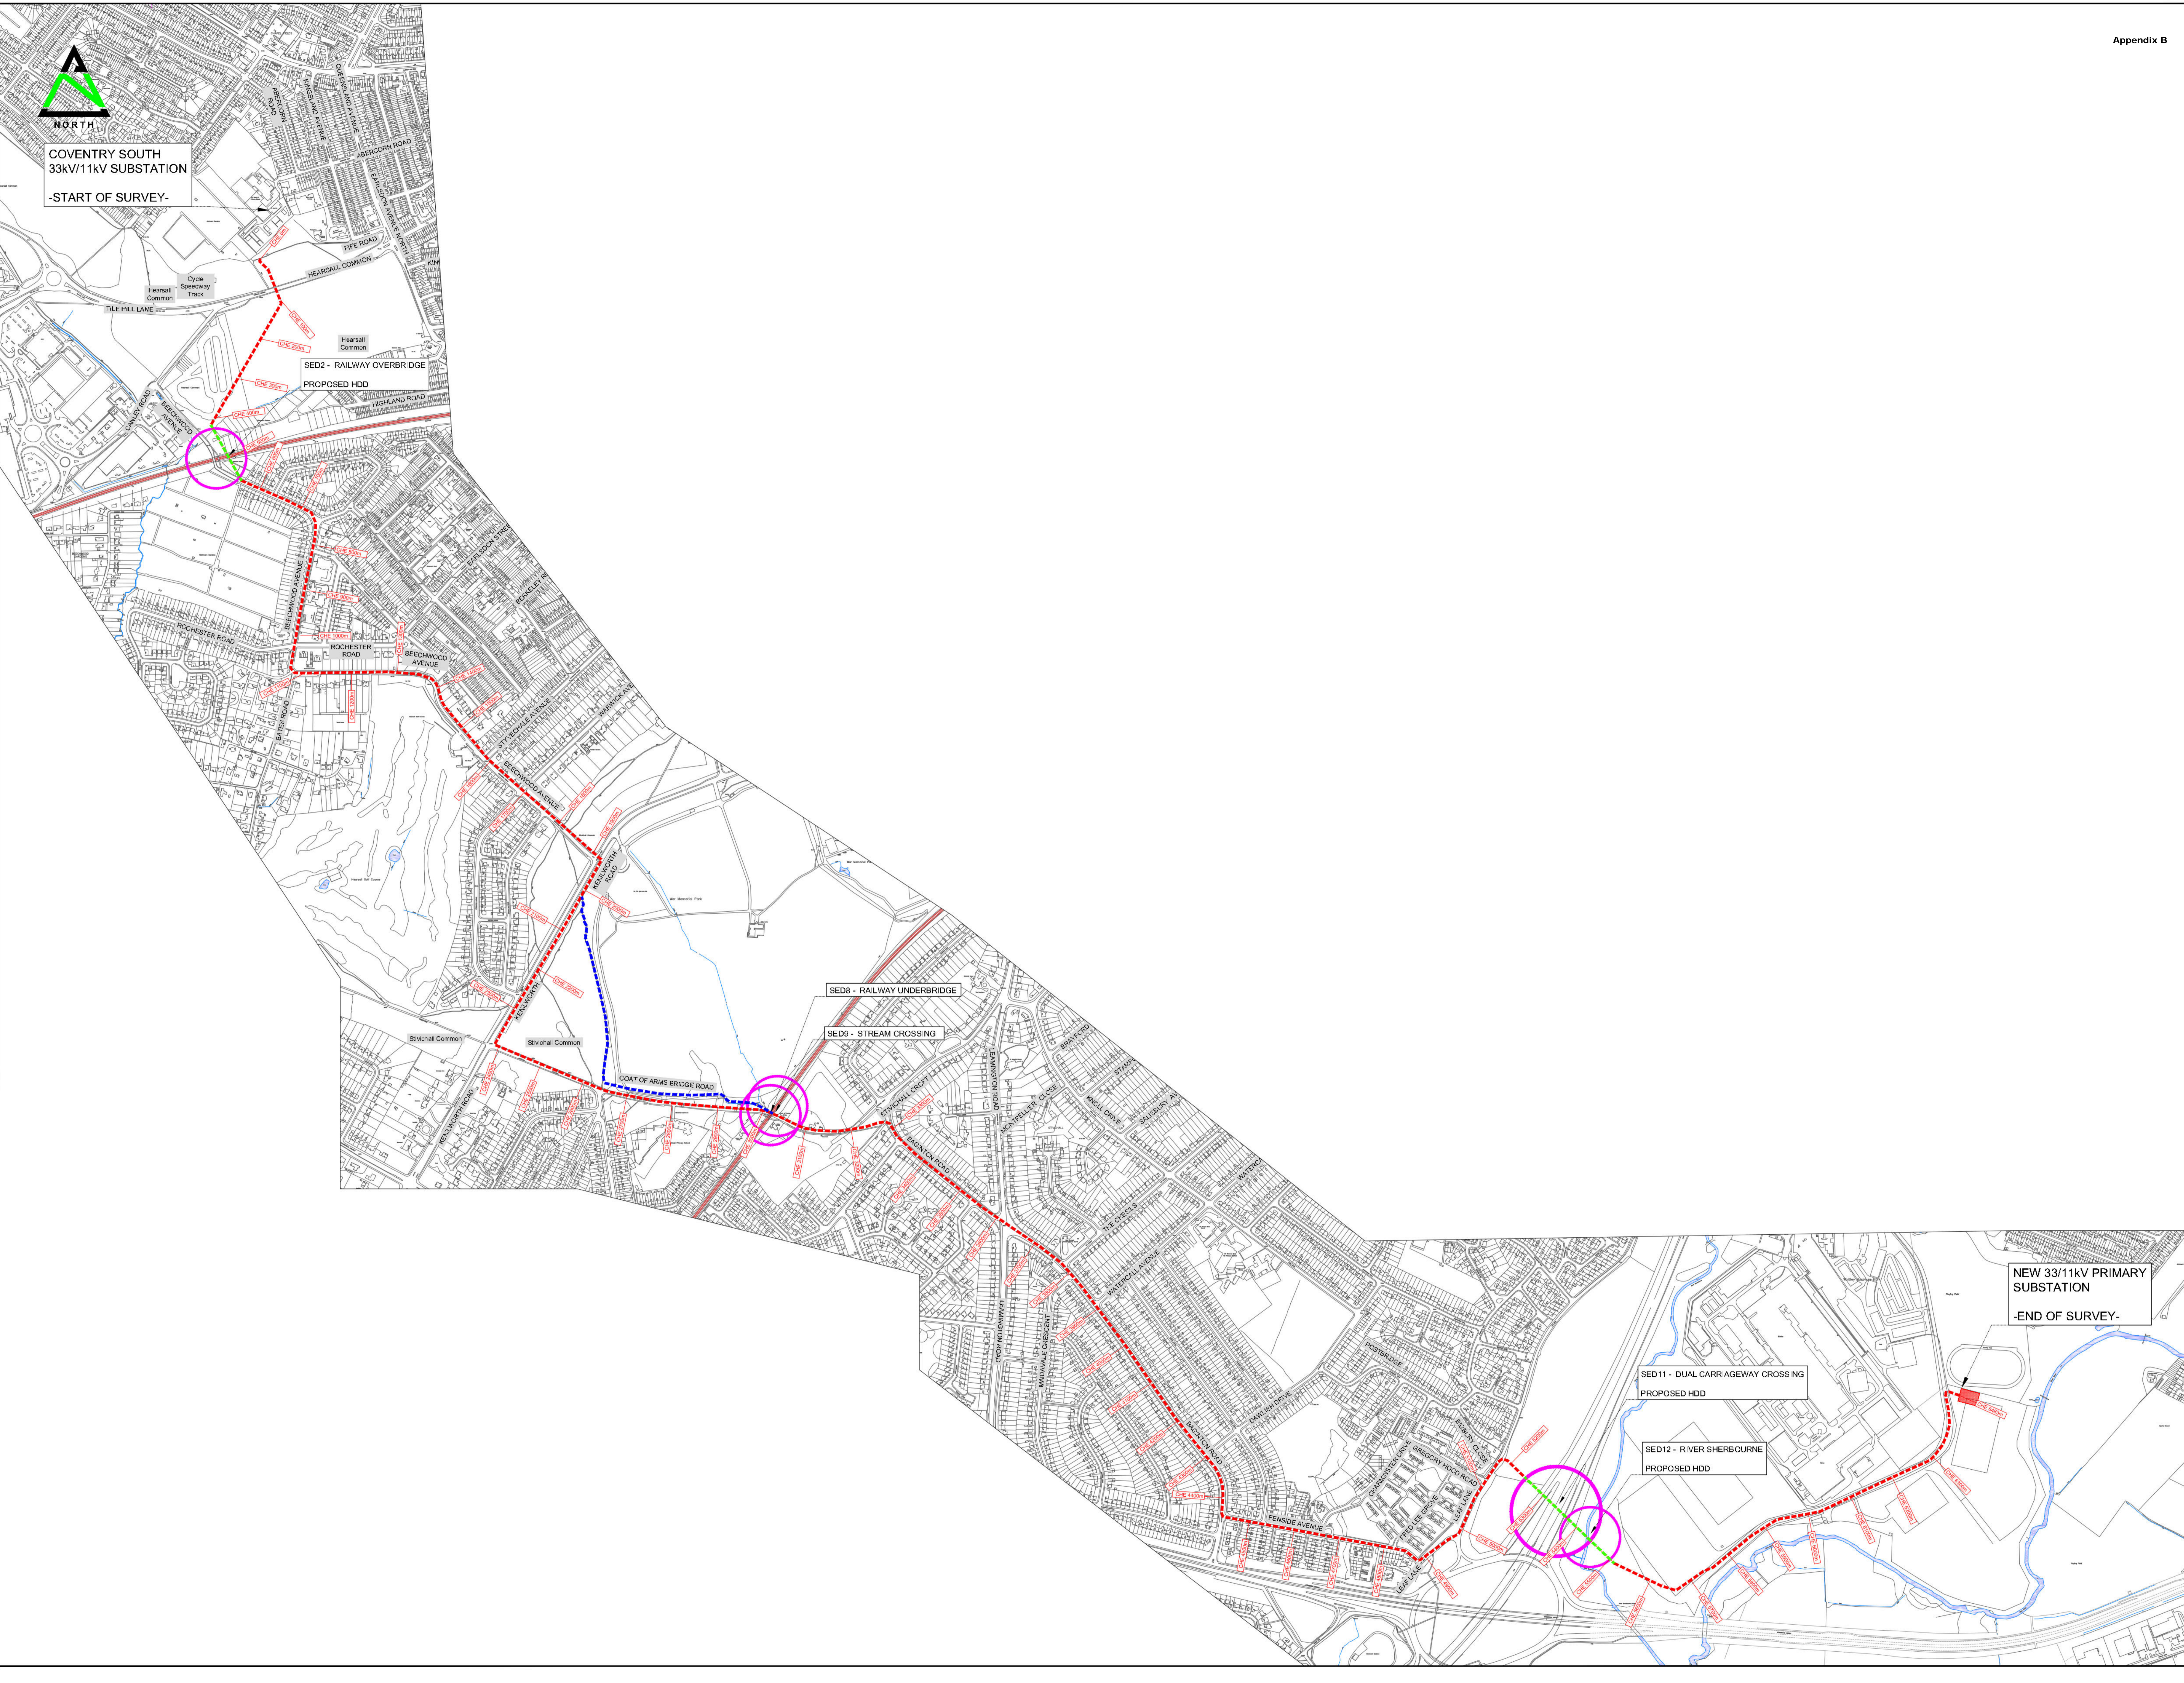

THIS DRAWING IS PROVIDED FOR INFORMATION ONLY.
 NO LIABILITY OF ANY KIND WHATSOEVER IS ACCEPTED BY THE
 CATSURVEYS GROUP, ITS AGENTS OR SERVICANTS FOR ANY THIRD PARTY
 ERRORS OR OMISSIONS.
 COPYRIGHT © CATSURVEYS GROUP LIMITED. REPRODUCTION OF THIS
 INFORMATION IS PROHIBITED WITHOUT WRITTEN AUTHORIZATION FROM
 CATSURVEYS GROUP LIMITED.
 ORDNANCE SURVEY © CROWN COPYRIGHT. ALL RIGHTS RESERVED.
 LICENCE NO. 100028187

REV	DATE	DESCRIPTION	DR	CHK	APP
0	08.10.16	Preliminary Drawing	AS	MB	-



CLIENT: **WESTERN POWER DISTRIBUTION**
Serving the Midlands, South West and Wales

PROJECT: JLR WHITLEY

TITLE: PROPOSED 33kV CABLE ROUTE

DRAWING No: WPD16312/SO/POINTS/01/01