




COVENTRY SOUTH  
33kV/11kV SUBSTATION  
-START OF SURVEY-

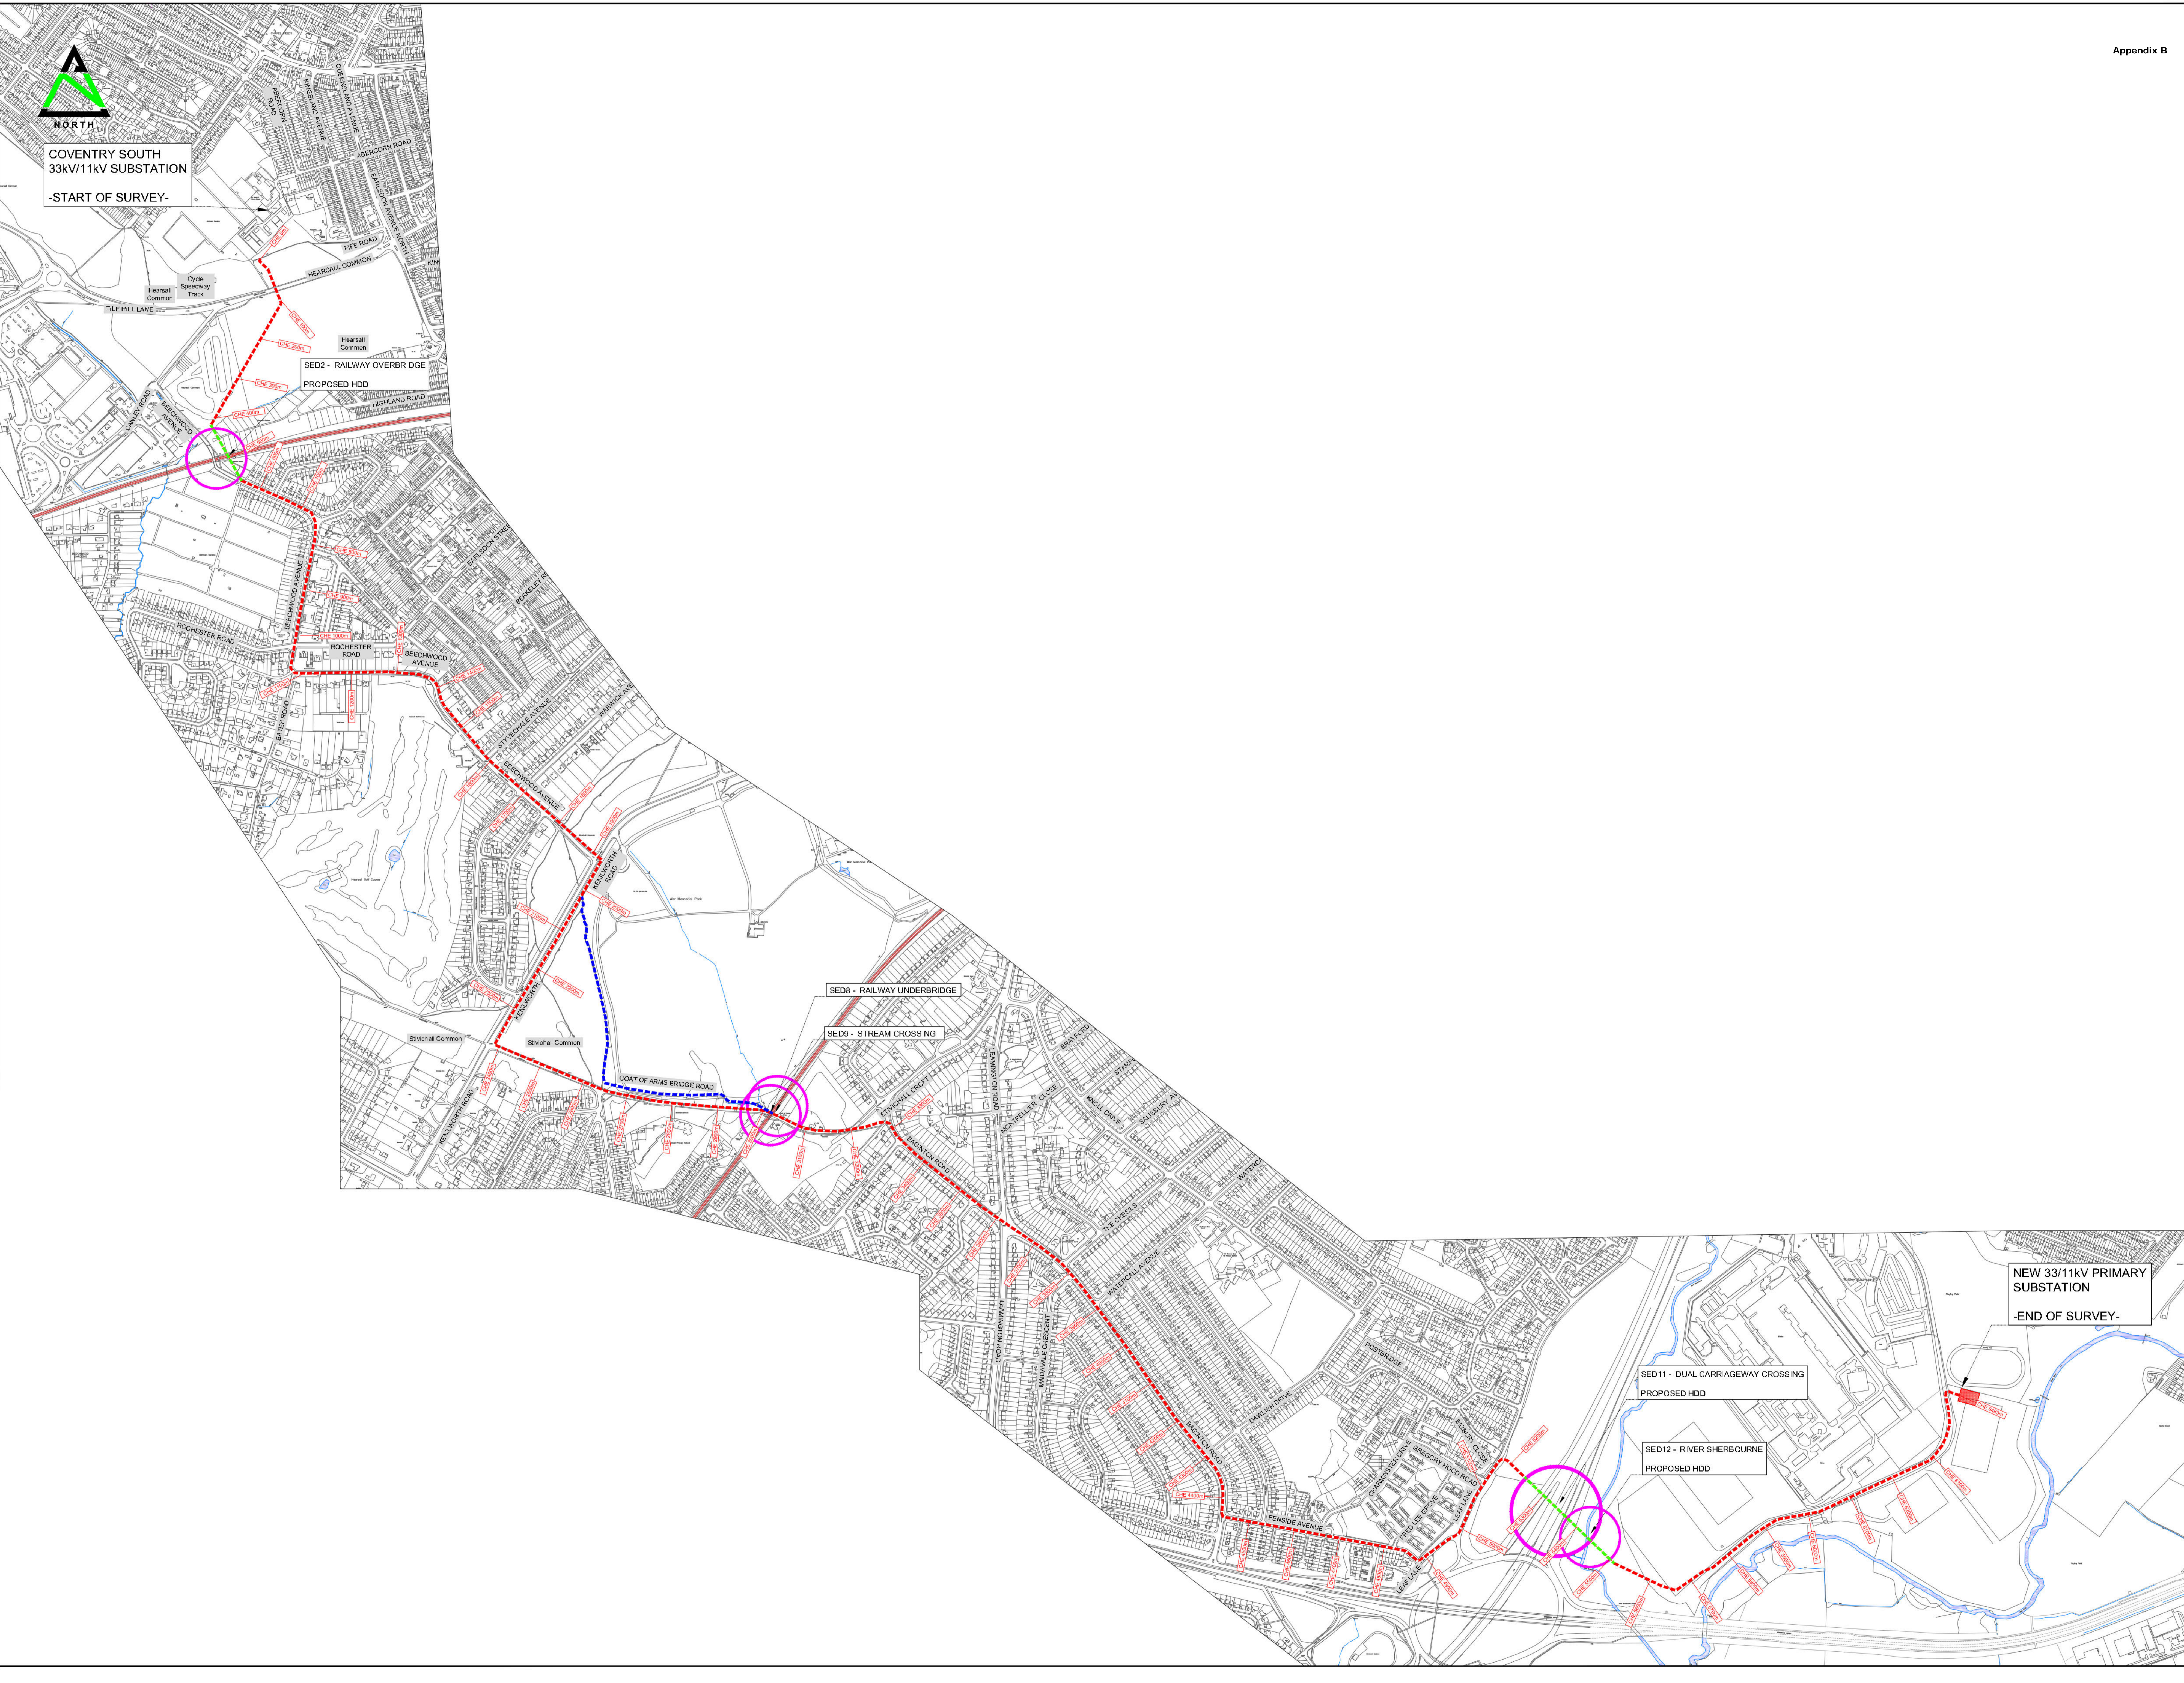

NEW 33/11kV PRIMARY  
SUBSTATION  
-END OF SURVEY-

Appendix B

**GENERAL NOTES**

The drawing must be opened in PDF (Portable Document Format) in order to activate the link features.  
 DOCUMENT CENTRE  
 The survey is based on Ordnance Survey National Grid OSG83S.  
 The accuracy of the digital data is the same as the plotting scale implies.  
 All dimensions are in metres unless otherwise stated.  
 DO NOT SCALE from this drawing, work to site dimensions.

**LEGEND**

- PROPOSED 33kV OPEN CUT TRENCH ROUTE ---
- ALTERNATIVE 33kV OPEN CUT TRENCH ROUTE ---
- PROPOSED HDD ---
- SPECIAL ENGINEERING DIFFICULTY ---
- RAILWAY TRACK / TRAMLINE ---
- RI/ND WATER ---

CIRCUIT	LENGTH (M)	PRIVATE LAND / PARKS	SPECIAL ENGINEERING DIFFICULTIES
33 kV CABLE	643	Part: Hearshall Common	5 (SECC SECC SECC SE011, SE012)

THIS DRAWING IS PROVIDED FOR INFORMATION ONLY.  
 NO LIABILITY OF ANY KIND WHATSOEVER IS ACCEPTED BY THE SURVEYOR'S GROUP, ITS AGENTS OR SERVANTS FOR ANY THIRD PARTY ERRORS OR OMISSIONS.  
 COPYRIGHT © CATSURVEYS GROUP LIMITED. REPRODUCTION OF THIS INFORMATION IS PROHIBITED WITHOUT WRITTEN AUTHORIZATION FROM CATSURVEYS GROUP LIMITED.  
 ORDNANCE SURVEY © CROWN COPYRIGHT. ALL RIGHTS RESERVED. LICENCE NO. 100028187

REV	DATE	DESCRIPTION	DR	CHK	APP
0	08.10.16	Preliminary Drawing	AS	MB	-



CLIENT: **WESTERN POWER DISTRIBUTION**  
*Spreading the Wealth, South West and Wales*

PROJECT: JLR WHITLEY

TITLE: PROPOSED 33kV CABLE ROUTE

DRAWING No: WPD16312/SO/POINTS/01/01